


ADVANCED HIGH CEILING Vela 6 - Emergency Pack




AD10 / Stem


Remote Emergency Pack

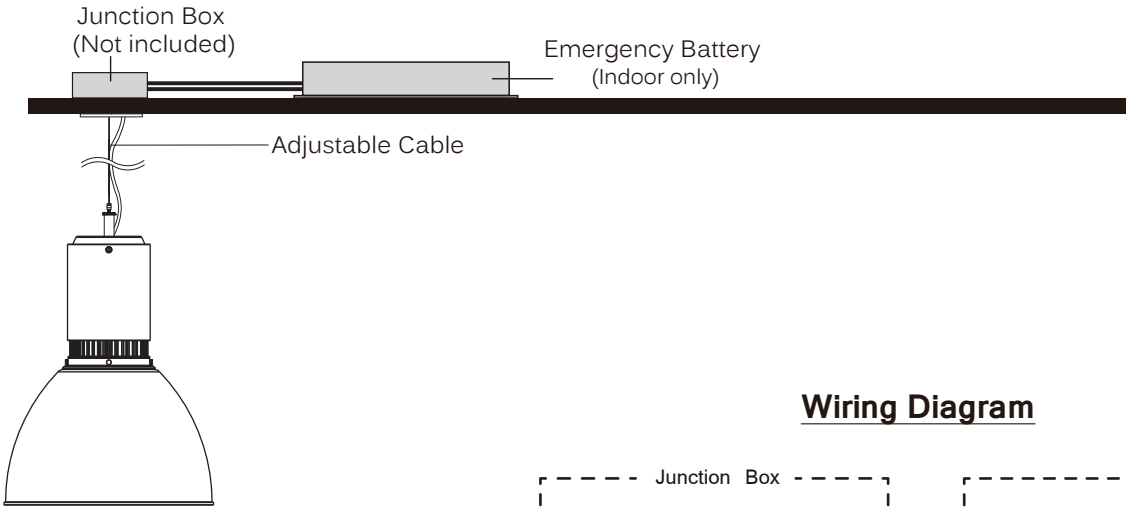

Wiring Diagram

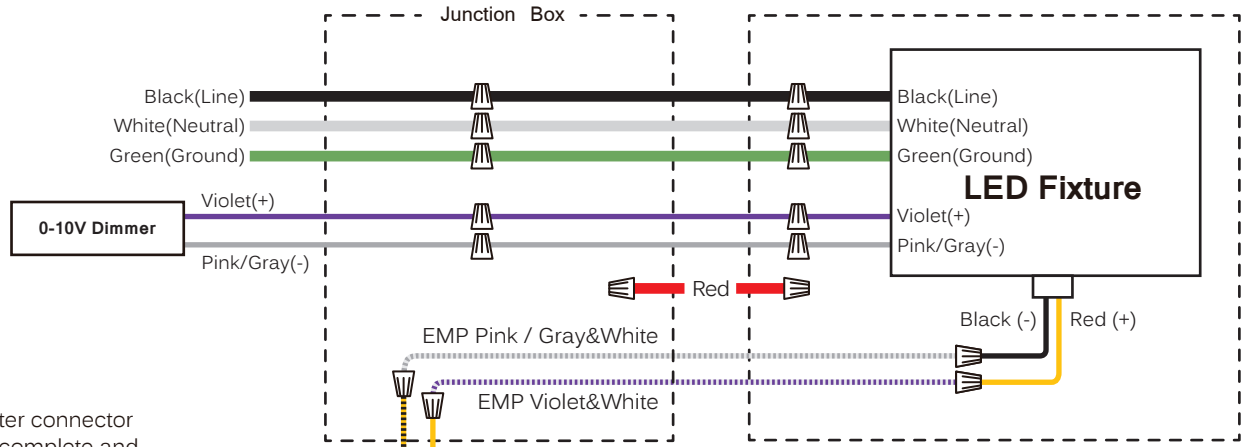

Do not join converter connector until installation is complete and AC power is supplied to the emergency driver.

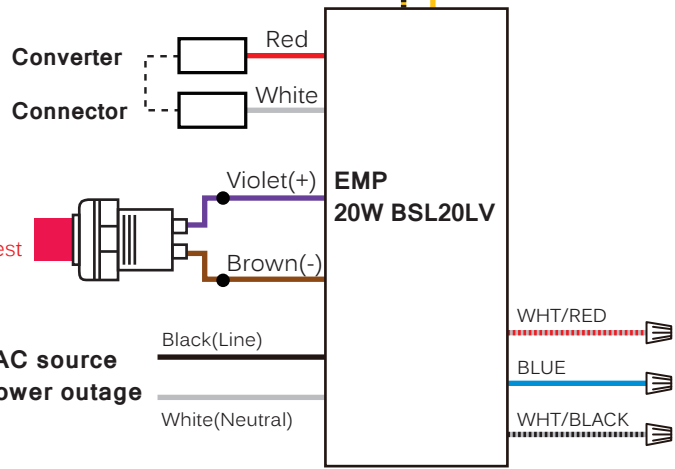

ATTENTION
Do not press the test switch button.

Test method

Disconnect the AC power of the LED fixture and EMP. The LED Fixture should be lit by EMP.